

WARNING - Electrical Requirements

Please pass onto your Electrician


warmup[®]
Est. 1994

Underfloor heating | Tiled shower solutions

483A Rosebank Road
PO Box 19-144, Avondale
Auckland, New Zealand
T: 0800 927 687
F: 09 820 7090
www.warmup.co.nz

Cross section for pre-wire requirements of undertile and undercarpet heating systems

The heating elements must be protected by a RCD with a rated residual operating current not exceeding 30mA

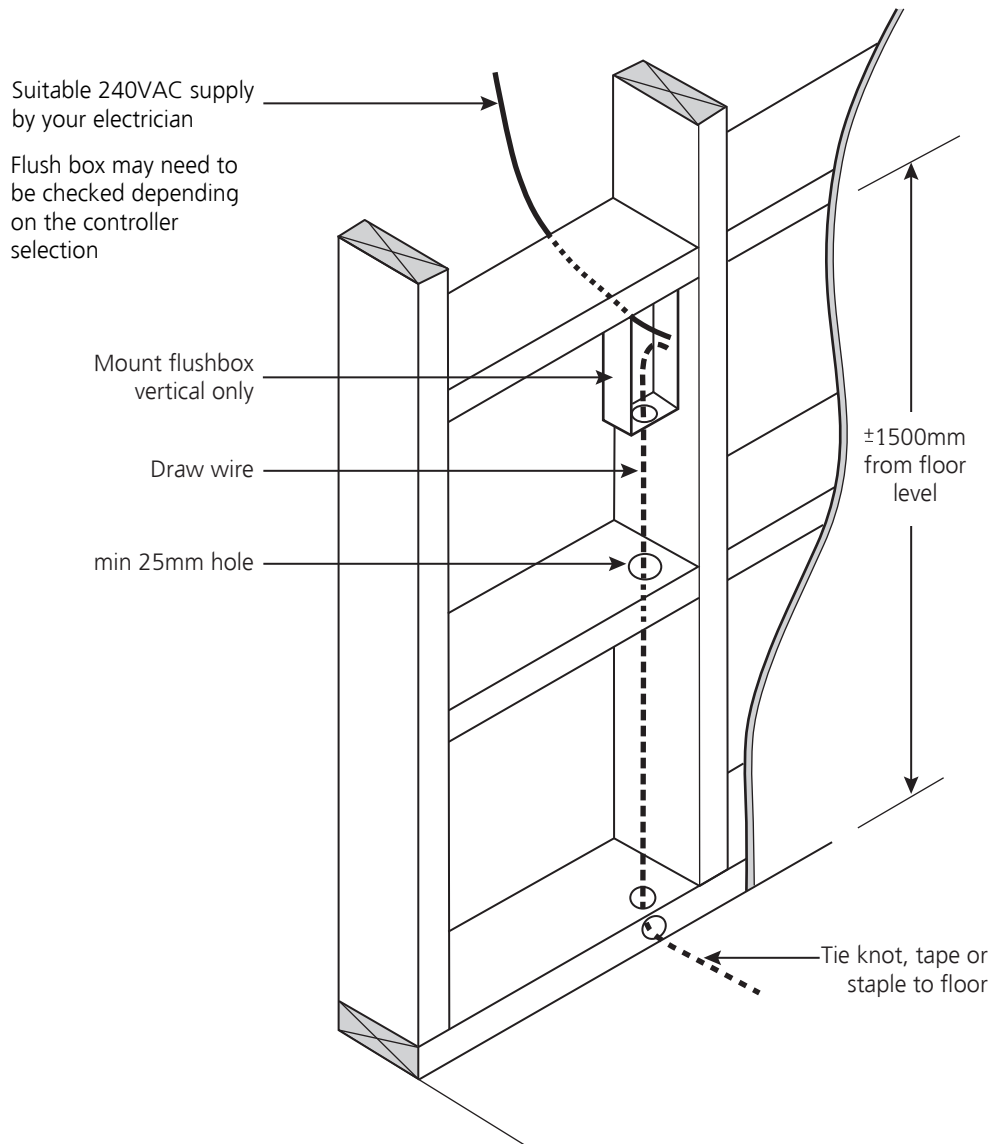

Notes:

1. All Warmup controllers are designed to fit Vertical flush boxes. The flush box should be installed within the room that is to be heated and accessible, typically adjacent to a light switch.
2. Height off the floor can vary with controllers.
3. The use of 2.5mm TPS as a draw wire is encouraged. Ensure that it has a clear unobstructed passage from floor to flush box.
4. Kindly contact us on 0800 WARMUP (927 687) for any queries.